



EVALUATION REPORT

FLORIDA BUILDING CODE 8TH EDITION (2023)

Manufacturer: IKO INDUSTRIES LTD
 40 Hansen Rd S
 Brampton, ON L6W 3H4
 Canada
 (905) 457-2880
www.iko.com

Issued October 5, 2023

Manufacturing Location: Kankakee, IL
 Sumas, WA
 Brampton, ON

Quality Assurance: PRI Construction Materials Technologies (QUA9110)

SCOPE

Category: Roofing
Subcategory: Underlayments
Code Edition: Florida Building Code, 8th Edition (2023) including High-Velocity Hurricane Zones (HVHZ)
Code Sections: 1518.3, 1523.1.1
Properties: Physical Properties

REFERENCES

<u>Entity</u>	<u>Report No.</u>	<u>Standard</u>	<u>Year</u>
PRI Construction Materials Technologies (TST5878)	IKO-216-02-01	ASTM D 1970	2017a
PRI Construction Materials Technologies (TST5878)	476C0002	ASTM D 1970	2017a
PRI Construction Materials Technologies (TST5878)	476C0013	ASTM D 1970	2017a
PRI Construction Materials Technologies (TST5878)	476C0023	ASTM D 1970	2017a
PRI Construction Materials Technologies (TST5878)	476C0047	ASTM D 1970	2017a

PRODUCT DESCRIPTION AND LIMITS OF USE

**Armourgard™
 Ice & Water Protector**
(Sumas and Brampton)

Armourgard™ Ice & Water Protector is an ASTM D 1970 self-adhered underlayment constructed from a non-woven glass fiber mat permeated and coated with SBS modified bitumen and is sanded on top. The product is supplied in 2 sq. rolls with nominal dimensions of 3-ft x 65-ft.

Armourgard™ Ice & Water Protector is permitted to be used with mechanically fastened asphalt shingles, wood shakes or shingles, and slate roofing as prescribed in the FBC. Exposure on the roof deck shall be limited to a maximum 30 days.

**StormShield™
 Ice & Water Protector**
(Kankakee)

StormShield™ Ice & Water Protector is an ASTM D 1970 self-adhered underlayment constructed from a non-woven glass fiber mat permeated and coated with SBS modified bitumen and is sanded on top. The product is supplied in 2 sq. rolls with nominal dimensions of 3-ft x 65-ft.

StormShield™ Ice & Water Protector is permitted to be used with mechanically fastened asphalt shingles, wood shakes or shingles, and slate roofing as prescribed in the FBC. Exposure on the roof deck shall be limited to a maximum 30 days.



**StormTamer™
Ice & Water Protector**
(Kankakee)

StormTamer™ Ice & Water Protector is an ASTM D 1970 self-adhered underlayment constructed from a non-woven glass fiber mat permeated and coated with SBS modified bitumen and is sanded on top. The product is supplied in 2 sq. rolls with nominal dimensions of 3-ft x 65-ft.

StormTamer™ Ice & Water Protector is permitted to be used with mechanically fastened asphalt shingles, wood shakes or shingles, and slate roofing as prescribed in the FBC. Exposure on the roof deck shall be limited to a maximum 30 days.

**GoldShield™
Ice & Water Protector**
(Brampton)

GoldShield™ Ice & Water Protector is an ASTM D 1970 self-adhered underlayment constructed from a non-woven glass fiber mat permeated and coated with SBS modified bitumen and is sanded on top. The product is supplied in 2 sq. rolls with nominal dimensions of 3-ft x 66.7-ft.

GoldShield™ Ice & Water Protector is permitted to be used with mechanically fastened asphalt shingles, wood shakes or shingles, and slate roofing as prescribed in the FBC. Exposure on the roof deck shall be limited to a maximum 30 days.

GoldSeam™
(Brampton)

GoldSeam™ is an ASTM D 1970 self-adhered tape constructed from a non-woven glass fiber mat permeated and coated with SBS modified bitumen and is sanded on top. The product is supplied in rolls with nominal dimensions of 4.25-in x 66.7-ft.

GoldSeam™ is permitted to be used with mechanically fastened asphalt shingles, wood shakes or shingles, and slate roofing as prescribed in the FBC. Exposure on the roof deck shall be limited to a maximum 30 days.

PRODUCT APPLICATION

Min. Roof Slope: 2:12 or in accordance in with FBC

Application: *All underlayments shall be installed in accordance with the FBC and the manufacturer's installation requirements.*

Deck substrates shall be clean, dry, and free from any irregularities and debris. All fasteners in the deck shall be checked for protrusion and corrected prior to underlayment application. Prior to beginning installation, the underlayment shall be unrolled and allowed to relax for a minimum of 3-5 minutes.

The roof deck shall be constructed in accordance with FBC requirements.

The underlayment shall be installed in accordance with the FBC with the release backer removed and pressed firmly into place to ensure complete contact with the substrate. The underlayment shall be installed with the roll length parallel to the eave, starting at the eave, and with minimum 3" side laps and minimum 6" end laps staggered 6-ft. from preceding course.

In the HVHZ, the underlayments shall be installed in accordance with FBC Section 1518.2.


Min. Application Temperature: 40°F; *Contact the manufacturer when installing at temperatures below the minimum application temperature.*

GENERAL LIMITATIONS

- 1) Fire Classification is not within the scope of this evaluation.
- 2) Wind Uplift resistance is not within the scope of this evaluation.
- 3) Installation of the evaluated product shall comply with this report, the FBC, and the manufacturer's published application instructions. Where discrepancies exist between these sources, the more restrictive and FBC compliant installation detail shall prevail.
- 4) The space under the deck area shall be properly ventilated in accordance with the FBC requirements.
- 5) The underlayment may be used as described in other current FBC product approval documents.
- 6) Roof coverings shall not be adhered directly to the underlayment unless otherwise approved in this or other current FBC product approval documents.
- 7) All products listed in this report shall be manufactured under a quality assurance program in compliance with Rule 61G20-3.

COMPLIANCE STATEMENT

The products evaluated herein by Zachary R. Priest, P.E. have demonstrated compliance with the Florida Building Code 8th Edition (2023) including High-Velocity Hurricane Zones (HVHZ) as evidenced in the referenced documents submitted by the named manufacturer.

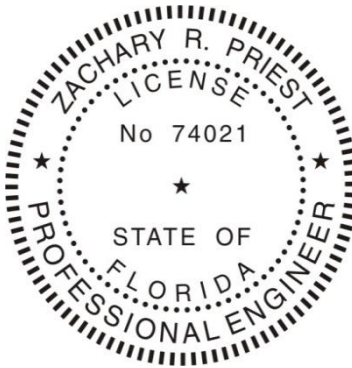

This item has been digitally signed and sealed by Zachary R. Priest, PE, on 10/5/2023.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Zachary R. Priest, P.E.
Florida Registration No. 74021
Organization No. ANE9641

CERTIFICATION OF INDEPENDENCE

CREEK Technical Services, LLC does not have, nor will it acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

CREEK Technical Services, LLC is not owned, operated, or controlled by any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

END OF REPORT