



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

IKO Industries Inc.
6 Denny Road, Suite 200
Wilmington, Delaware 19809

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: IKO EDGESEAL

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA# 19-1112.05 and consists of pages 1 through 4.
The submitted documentation was reviewed by Alex Tigera.

12/07/23



NOA No.: 23-0417.01
Expiration Date: 12/13/28
Approval Date: 12/07/23
Page 1 of 4

ROOFING COMPONENT APPROVAL

Category: Roofing
Sub-Category: Underlayment
Materials: Polypropylene

SCOPE

This approves **EdgeSeal®** self-adhered roof starter manufactured by IKO Industries Ltd. as described in this Notice of Acceptance, designed to comply with Florida Building Code, High Velocity Hurricane Zone.

PRODUCT DESCRIPTIONS:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
EdgeSeal	Width: 8-7/8" Length: 67'	ASTM D 1970 & TAS 114 (H)	Self-adhered roof starter

MANUFACTURING LOCATION:

1. Brampton, ON (Canada)

EVIDENCE SUBMITTED:

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
PRI Construction Materials	IKO-173-02-01	TAS 100	05/08/18
Technologies, LLC	IKO-174-02-01	TAS 100	05/08/18
	IKO-175-02-01	ASTM D 1970	09/28/17
	IKO-191-02-01	ASTM D 7105	05/08/18

LIMITATIONS

1. Fire classification is not part of this acceptance; refer to a current Approved Roofing Materials Directory for fire ratings of this product.
2. Shall not be installed on roof mean heights in excess of 33 ft.
3. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.

INSTALLATION

1. Shingles shall be installed in compliance with Roofing Application Standard RAS 115.
2. Flashing shall be in accordance with Roofing Application Standard RAS 115
3. The manufacturer shall provide clearly written application instructions.
4. At the eave, EdgeSeal will serve as starter coarse and may be used as an option to the 8-in wide strip of flashing cement. The first shingle course will be set atop the EdgeSeal as seen in Detail 'A', attached.
5. At the rake and vally, shingles will be set atop EdgeSeal. Cut pieces of EdgeSeal or ASTM C920 sealant is to be placed within the head lap, between subsequent courses, to seal rake or valley edge exposure. See Detail 'B' and Detail 'C', attached for intallation diagram.



LABELING

Shingles shall be permanently labeled with the manufacturer's name and/or logo, city and state of manufacturing facility, and the following statement: "Miami-Dade County Product Control Approved" or with the Miami-Dade County Product Control Seal as seen below:



BUILDING PERMIT REQUIREMENTS:


Application for building permit shall be accompanied by copies of the following:

1. This Notice of Acceptance
2. Any other documents required by the building official or the Applicable Building Code in order to properly evaluate the installation of this system.


Detail A Installation at the Eave




Detail B
Installation at the Rake
View 1

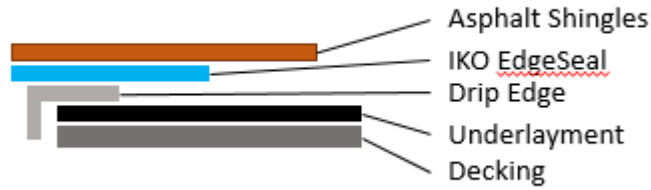

View 2

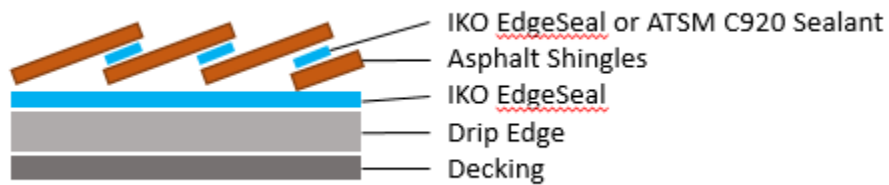

Detail C
Installation at the Valley

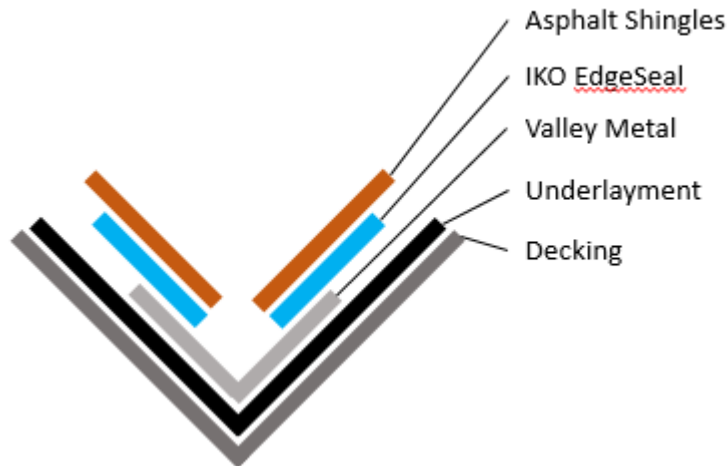

END OF THIS ACCEPTANCE